







The Thermostat should be mounted at least 300mm away from the heater, and protected from artificial heat sources for example: Desktop computers, TV's, Desk lamps etc. The Thermostat should be mounted at chest height or mounted in the dado trunking above the workstation. Mount in a 25mm or greater back box.



Rear view of Thermostat

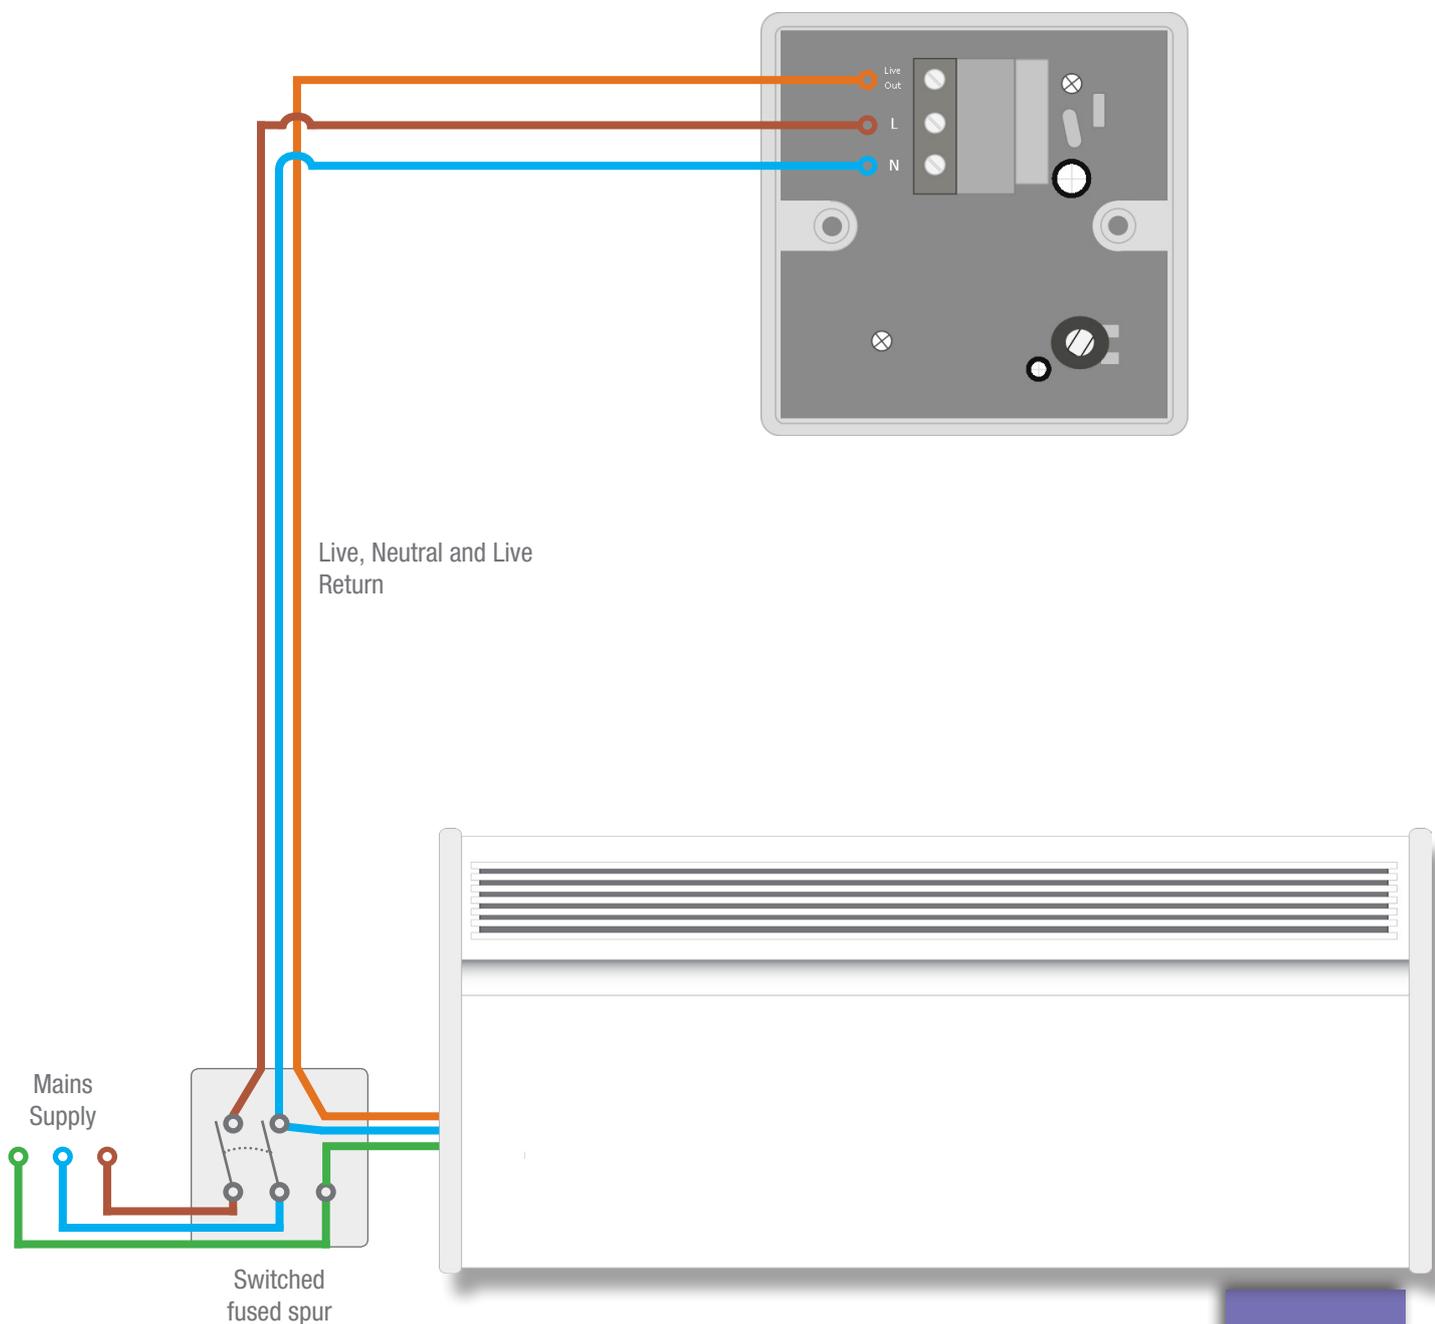


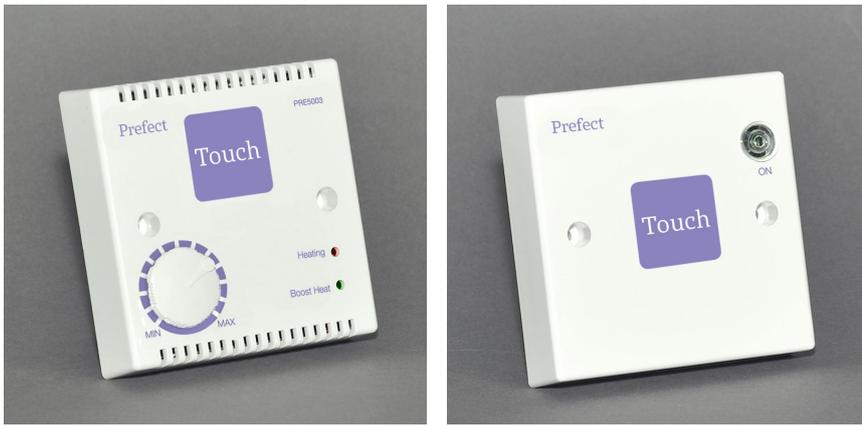

The Thermostat should be mounted at least 300mm away from the heater, and protected from artificial heat sources for example: Desktop computers, TV's, Desk lamps etc. The Thermostat should be mounted at chest height or mounted in the dado trunking above the workstation. Mount in a 25mm or greater back box.




Rear view of Thermostat

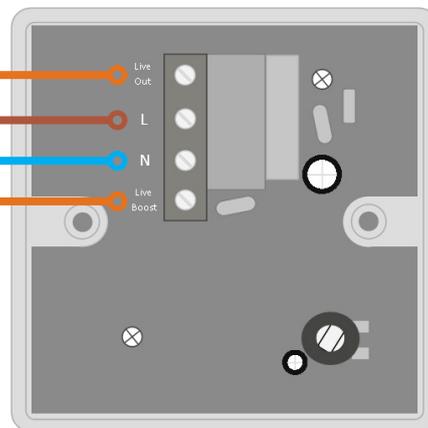

230V Remote boost trigger

Live, Neutral and Live Return

Live and Neutral to Timer

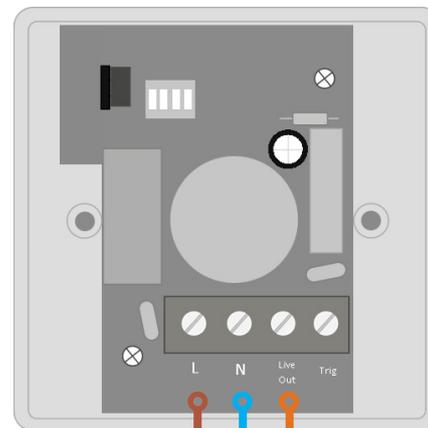

Rear view of PRE9280UNI Timer

