PRE3201-VFC PIR

Ceiling-mounted PIR with manual setup & Volt free contact

Wiring diagram **page 1** of 1

Cleverly simple
control of energy.

Avoid direct sunlight entering the sensor, Do not site within 1M of forced heating/cooling ventilation. To flush mount cut a 64mm hole in the celling. The sensor can also be mounted in an optional EBDBB Back box. Note that the lower the sensor is mounted the smaller the detection range will be.

Rear view of Sensor

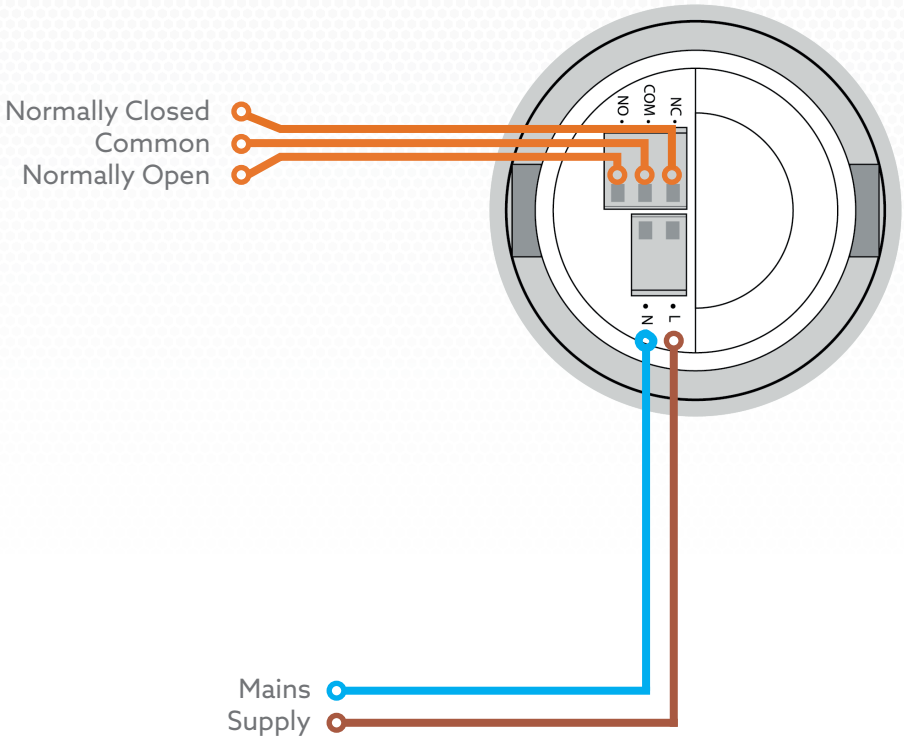

Due to our policy of continuous improvement, we reserve the right to change specifications without notice.
All information was correct at time of when this product file was produced - April 2020

Prefect Controls Limited, Unit 2, Church Field Business Park, Church Field Road, Sudbury CO10 2YF
01787 320604 | **mail@prefectcontrols.com** | **prefectcontrols.com**