PRE3204

No neutral wall-mounted PIR

Wiring diagram **page 1** of 1

Prefect

Cleverly simple **control** of energy.

Rear view of Sensor

Avoid direct sunlight from entering the sensor, Do not site within 1 Metre of forced heating/cooling ventilation, do not site within 1 Metre of any lighting. Mount in a surface or sunken pattress box of 25mm or greater, do not mount on a vibrating surface. Mount the sensor between 1.2 and 1.5 Meters, Note that the higher the sensor is mounted the shorter the detection range will be.

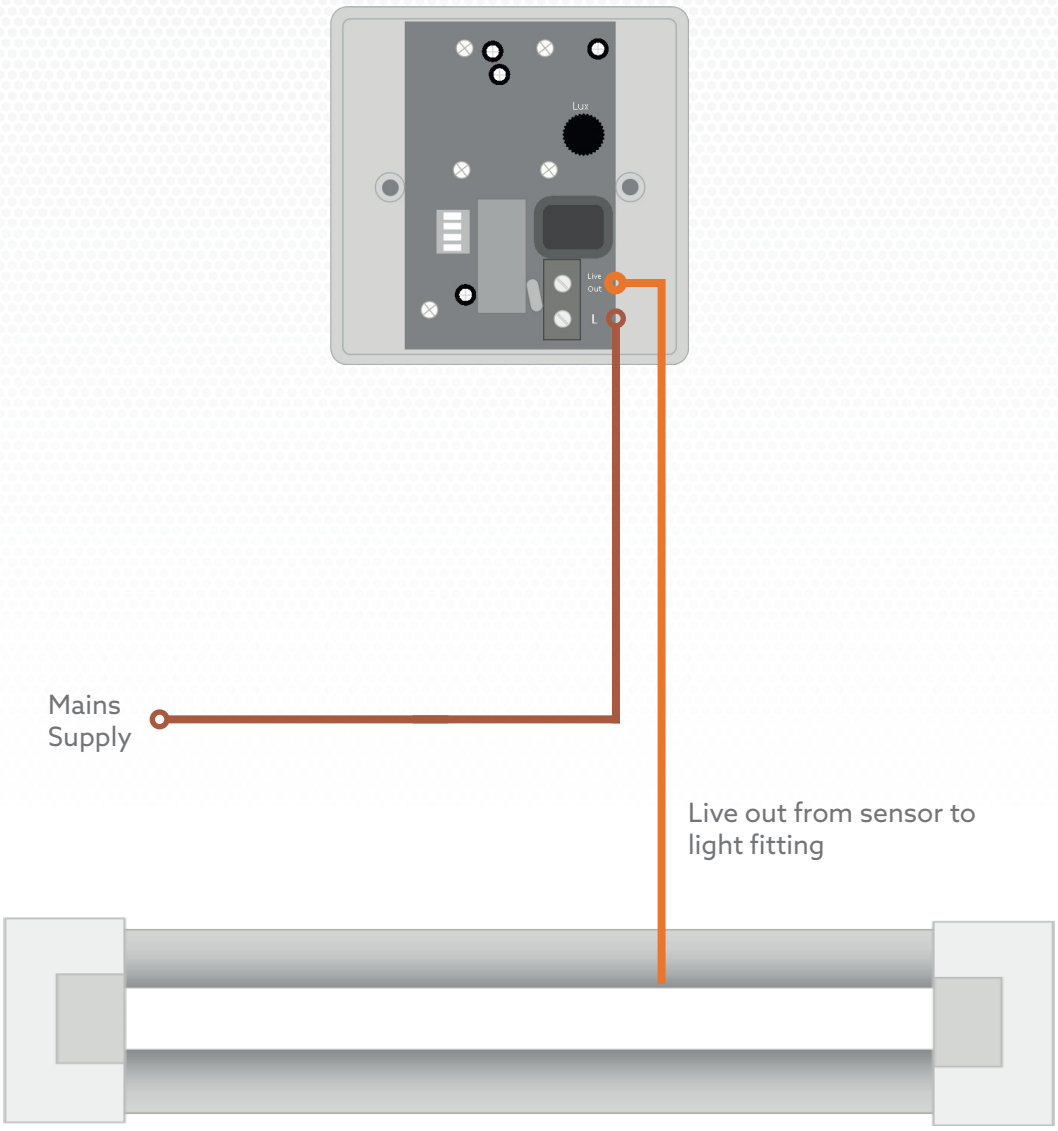

Due to our policy of continuous improvement, we reserve the right to change specifications without notice.
All information was correct at time of when this product file was produced - April 2020

Prefect Controls Limited, Unit 2, Church Field Business Park, Church Field Road, Sudbury CO10 2YF
01787 320604 | **mail@prefectcontrols.com** | **prefectcontrols.com**