PRE4201

Wall-mounted microwave sensor

Wiring diagram **page 1** of 1

Prefect

Cleverly simple
control of energy.

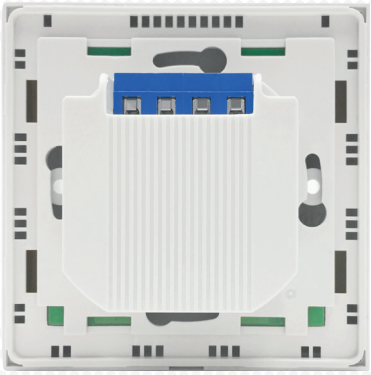

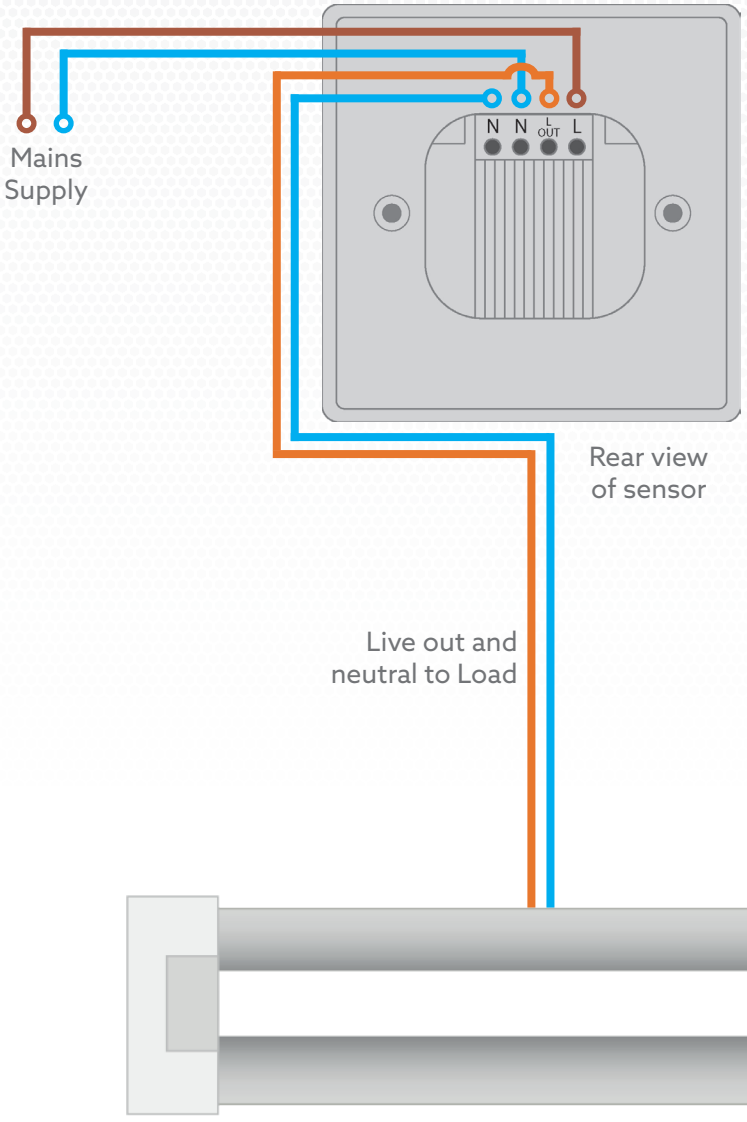

Mount 1.2 to 1.5 meters from the floor, note The higher the sensor is mounted the shorter the detection range will be. Do not site within 1 meter of any lighting or ventilation equipment, do not fix to a vibrating surface, site as far away from any metal surface as possible. Mount in a 25mm or larger back box.

Due to our policy of continuous improvement, we reserve the right to change specifications without notice.
All information was correct at time of when this product file was produced - April 2020

Prefect Controls Limited, Unit 2, Church Field Business Park, Church Field Road, Sudbury CO10 2YF
01787 320604 | **mail@prefectcontrols.com** | **prefectcontrols.com**