

PRE4203

Ceiling-mounted microwave sensor with adjustable head


Wiring diagram page 1 of 1



Cleverly simple
control of energy.



Rear view of sensor

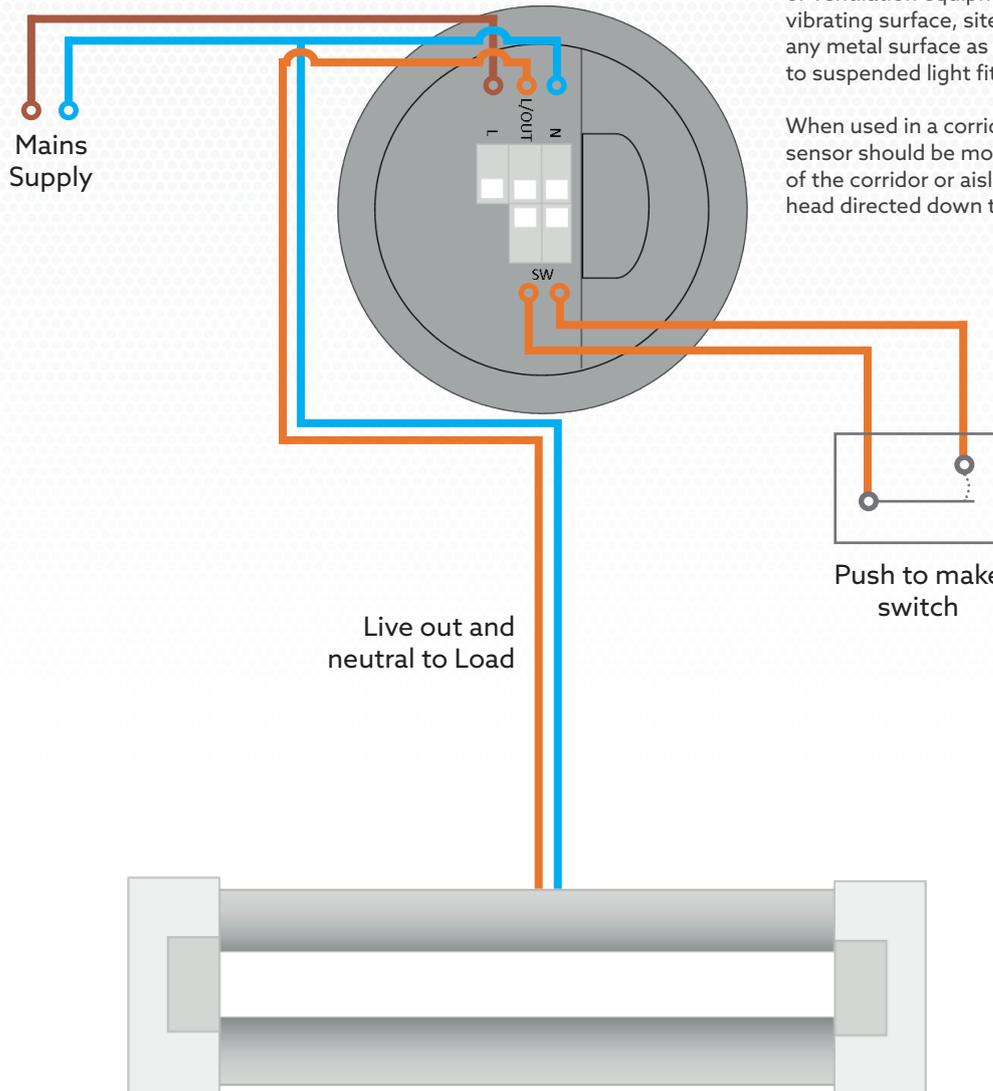

Do not site within 1 meter of any lighting or ventilation equipment, do not fix to a vibrating surface, site as far away from any metal surface as possible, do not fix to suspended light fitting.

When used in a corridor or aisle the sensor should be mounted at the end of the corridor or aisle with the detector head directed down the corridor or aisle.

Due to our policy of continuous improvement, we reserve the right to change specifications without notice. All information was correct at time of when this product file was produced - April 2020